

# Model 911®E ETS

www.lawlervalue.com


**DATA SHEET**

## Emergency Tempering System for Combination Emergency Shower and Eyewash Equipment

ENG. NO. 87200-A

Unit No. 87200

ASSE Lead Free  
Certified

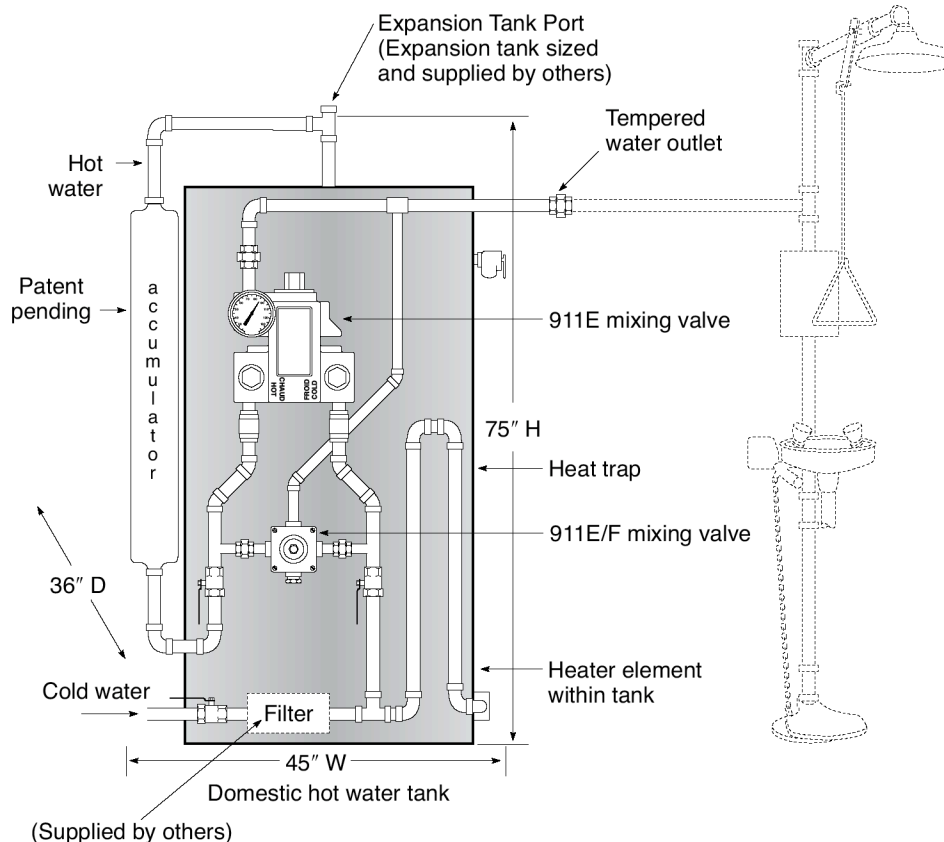

The Emergency Tempering System shall consist of a water heater storage tank and 120V 20AMP heating element. The Emergency Tempering System shall incorporate 2 emergency mixing valves capable of controlling outlet temperature over a wide range of flows and employ a liquid-filled thermostatic motor and a stainless steel sliding piston control device. The valves shall offer positive hot water shut-off in the event of cold water supply loss and full flow cold water bypass in the event of hot water supply loss or thermostatic failure. The system shall also incorporate a device capable of flattening temperature spike through the system as well as a heat trap to prevent heat migration to the cold side of the mixing valve.

Unit supplied complete with pre-piped 118 gallon storage tank, 120V 20 AMP heating element, Lawler accumulator (patent pending), 911®E and 911®E/F Emergency Mixing Valves. Approximate weight empty = 600 lbs.

The hot water tank is UL listed, heating element is CSA approved and the housing has a Nema #4 rating.

### Options

Combination Shower and Eyewash Equipment

- ☐ Guardian G 1902 P
- ☐ Haws 8320
- ☐ Speakman SE-697
- ☐ Other, please specify \_\_\_\_\_

Cold water filter

- ☐ Please specify \_\_\_\_\_
- ☐ Nema 7 rated box-Explosion proof.  
Please call factory for pricing.

Special tank or power requirements, please contact factory.

Design and specification subject to change without notice.



**MANUFACTURING CO., INC.**

5330 East 25th Street  
Indianapolis, Indiana 46218  
Phone (317) 261-1212  
Fax (317) 261-1208